Prof. Corbato

EQUIPMENT CONFIGURATION
GE 645 - MAC
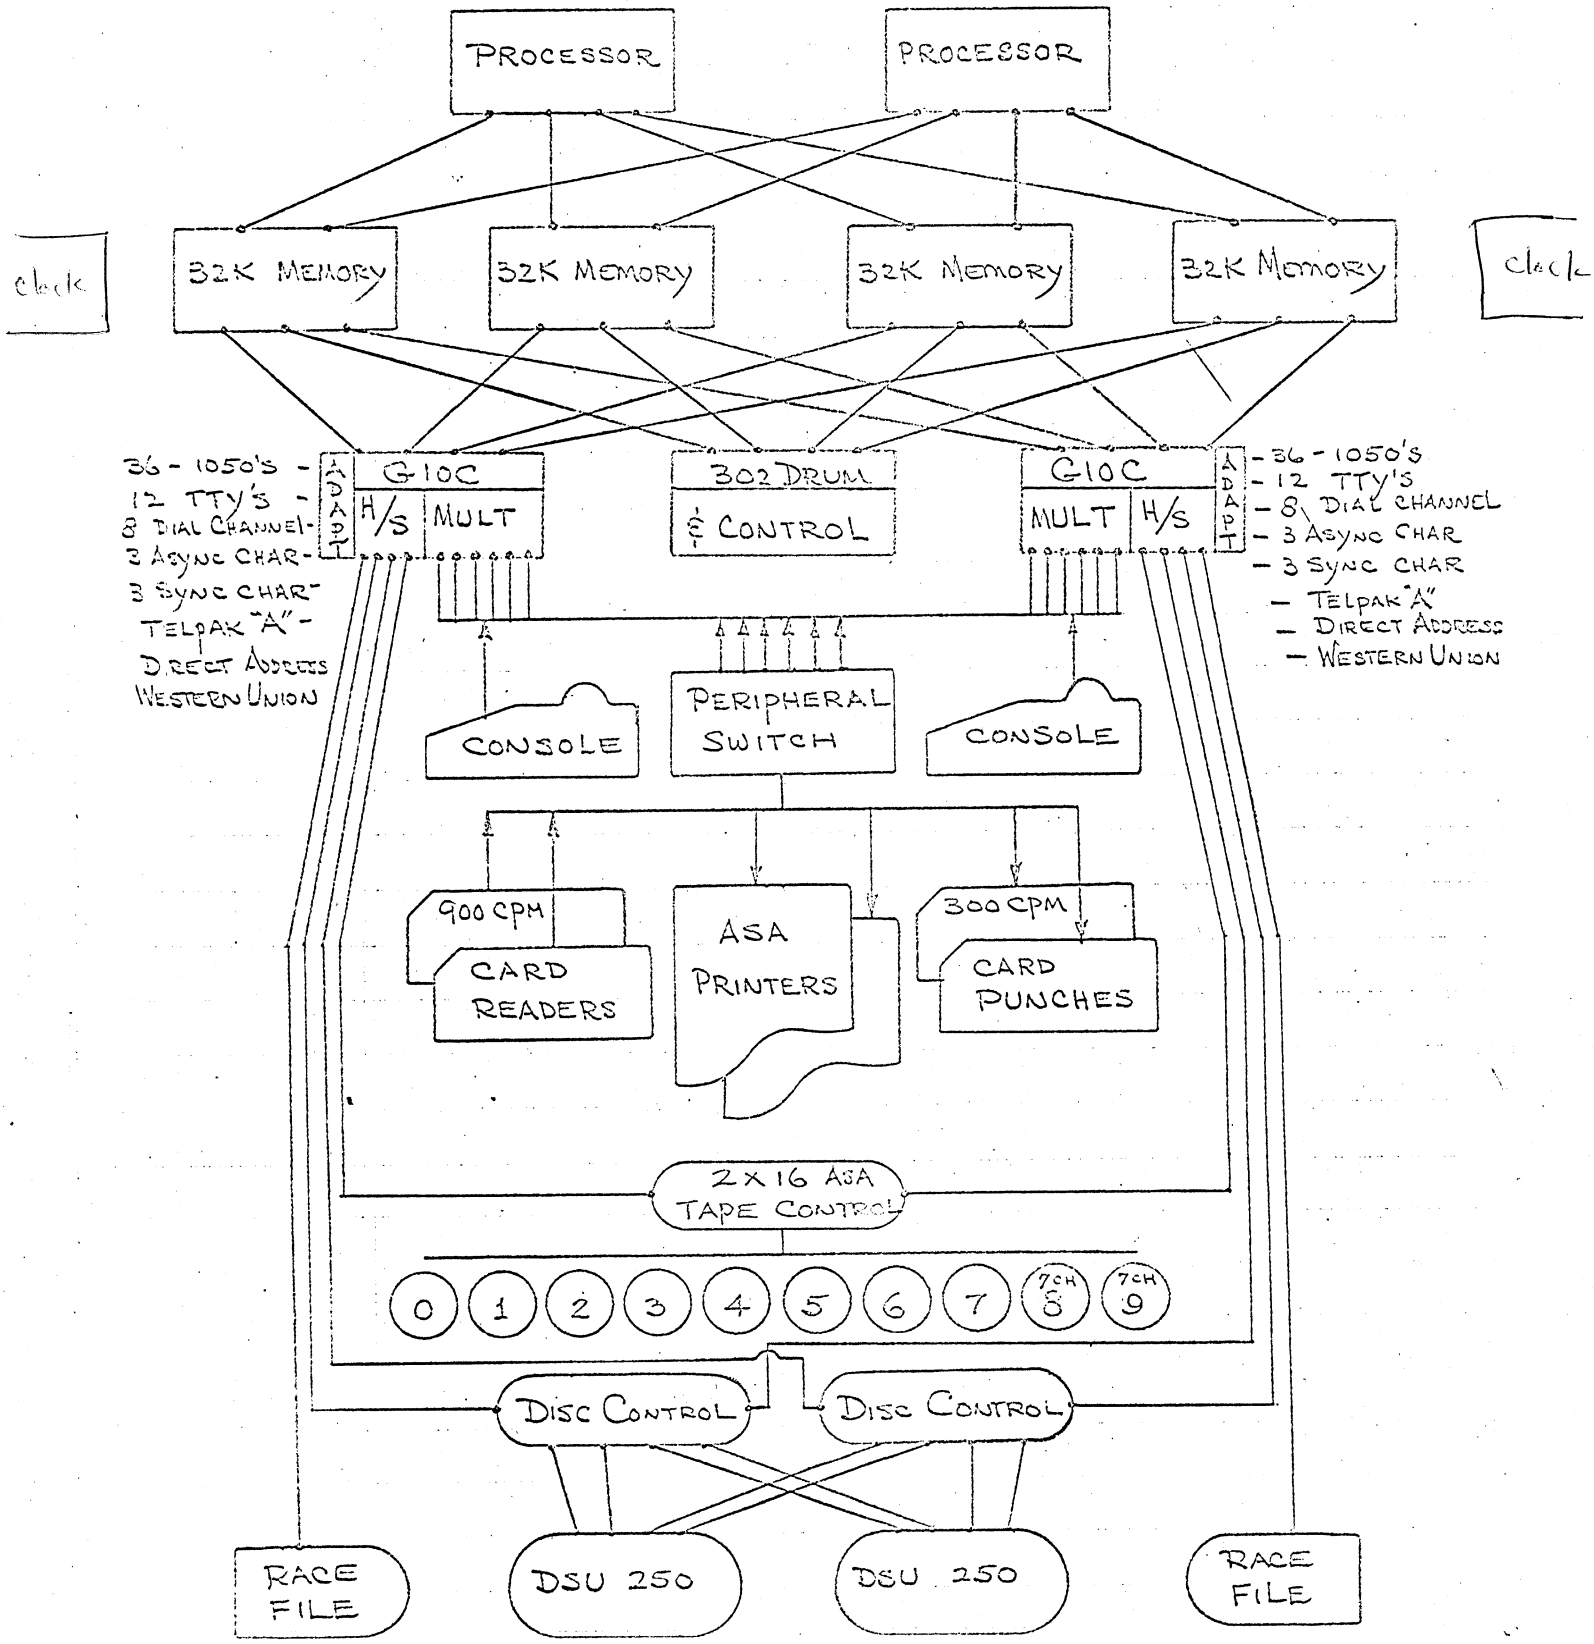
6/14/66